


Figure 16. Continuous Reaction Apparatus,

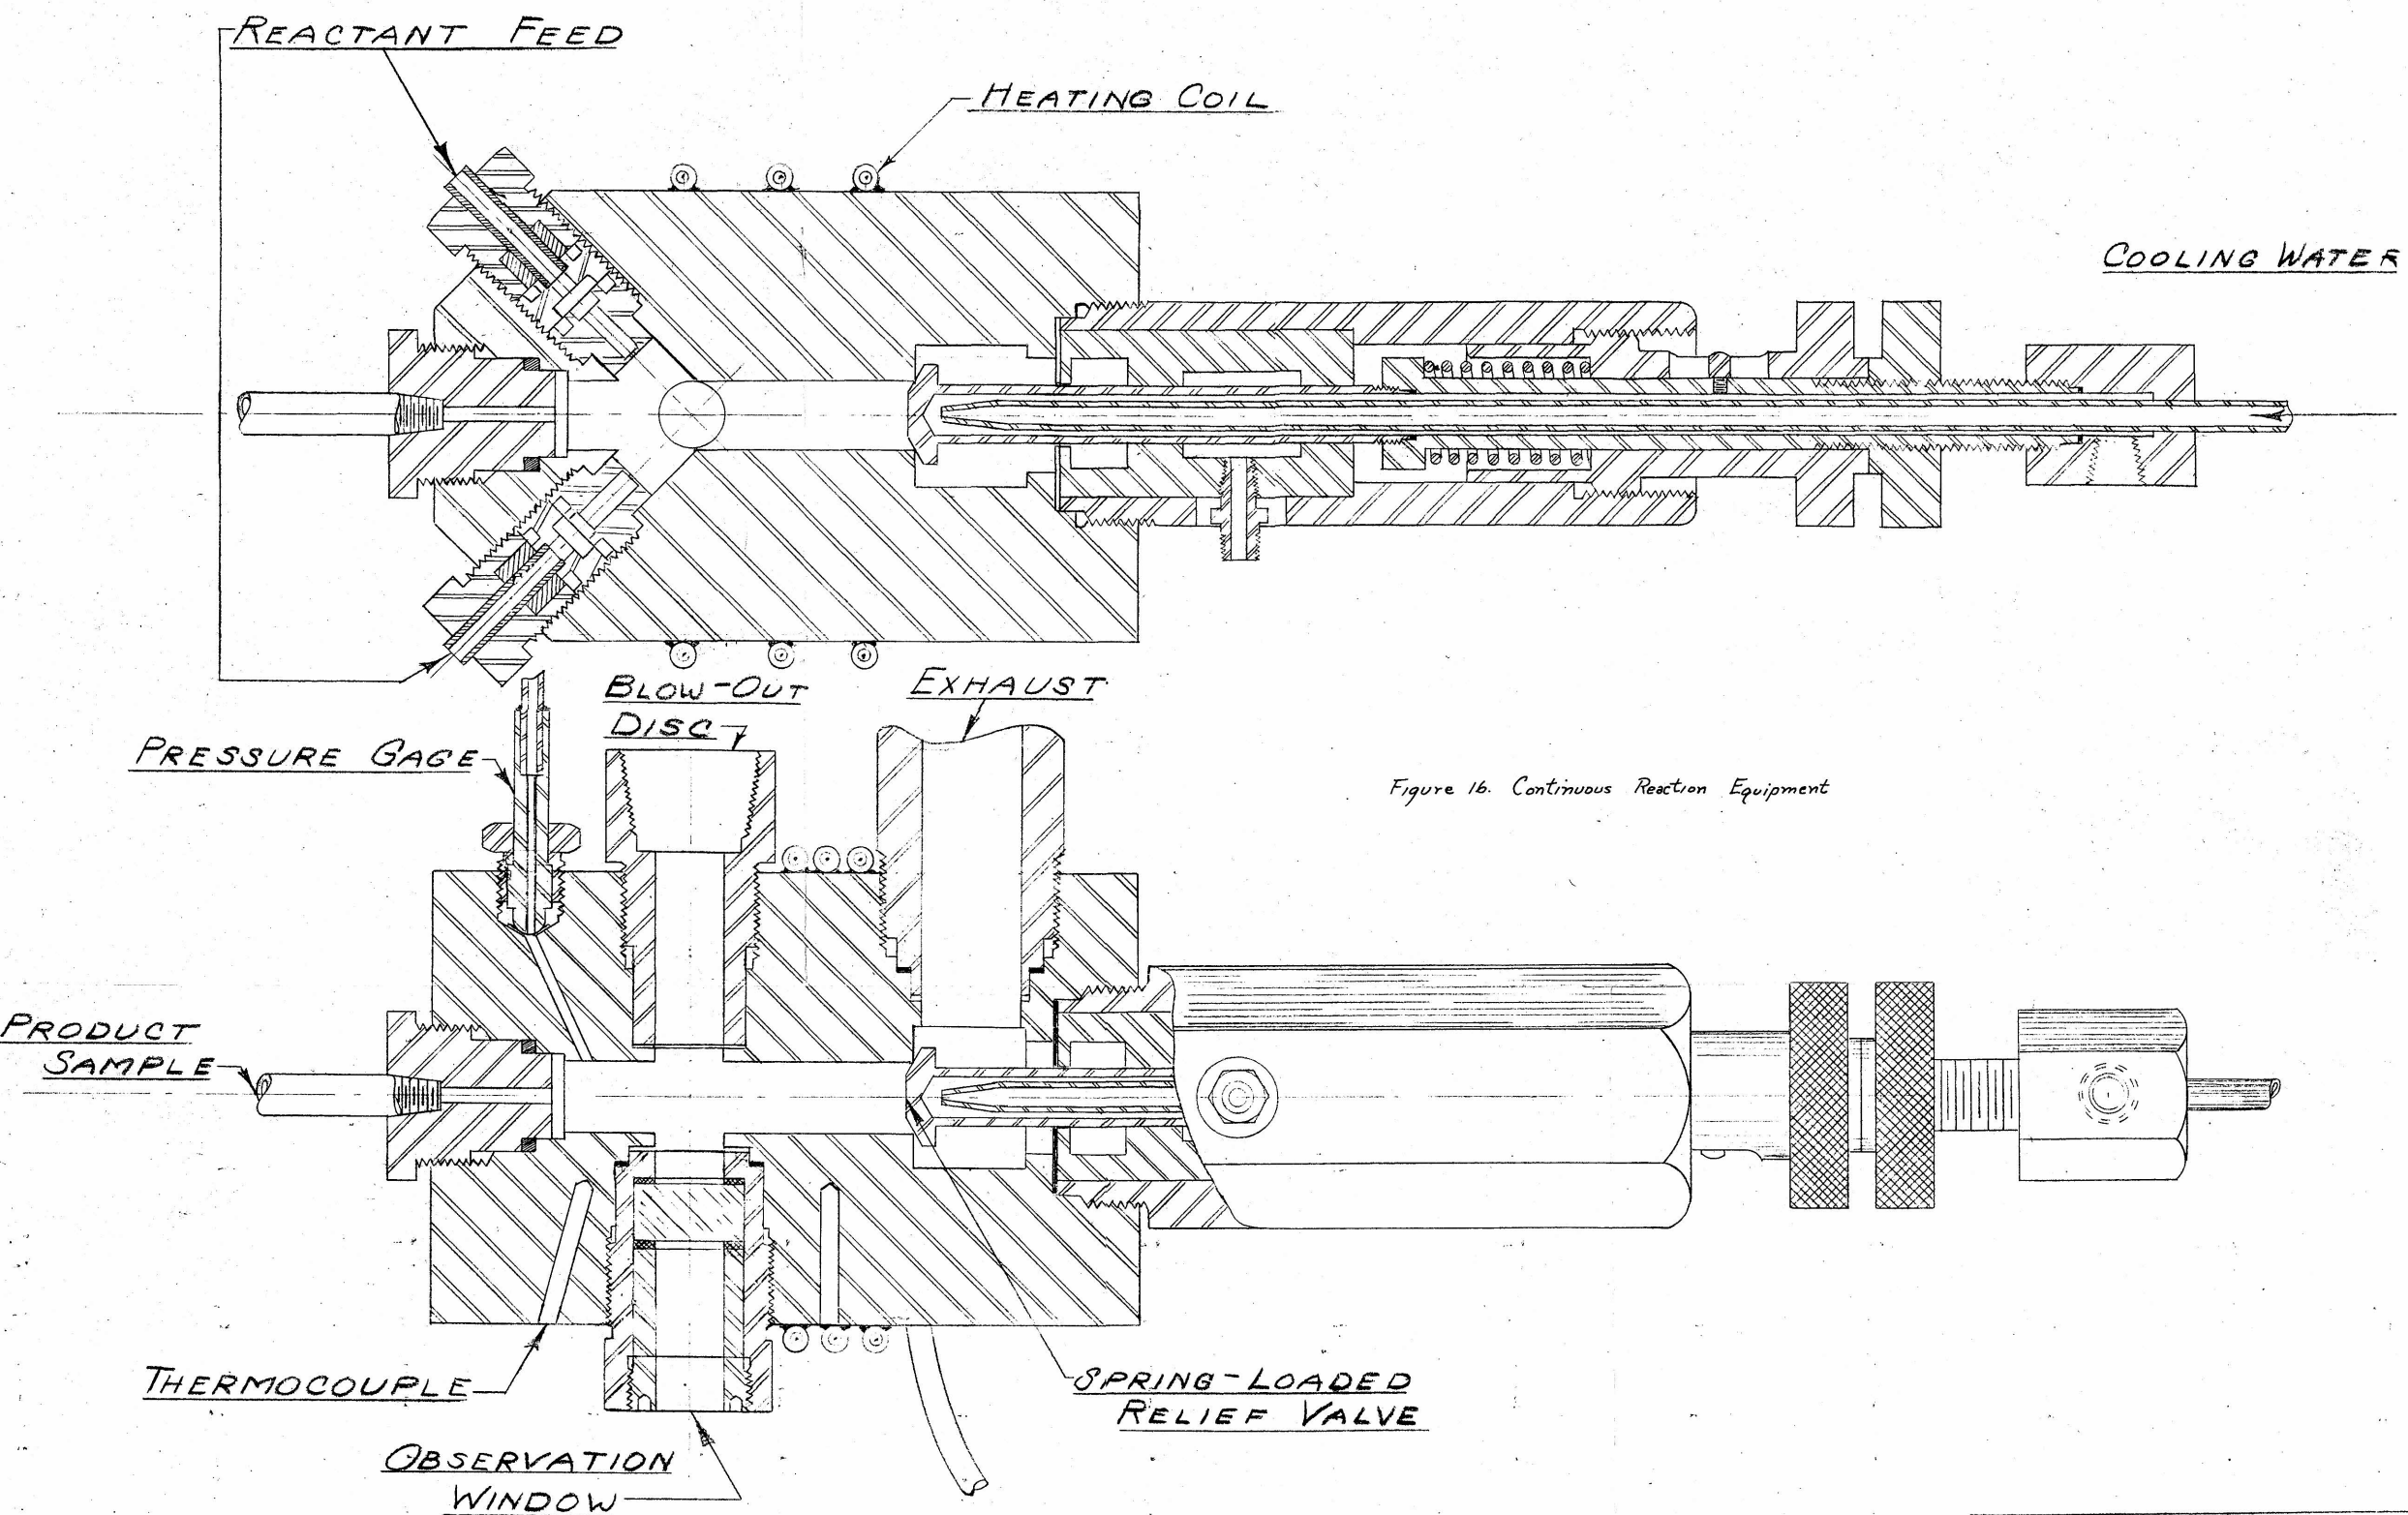

REVISION OF GALCIT CHAMBER 480°C

CALIF. INST. OF. TECH
DEPT OF CHEM. ENG

GALCIT #1

DATE	DRAWN	CHKD	APRD	PLATE
1-31-42	Gale			632-C