



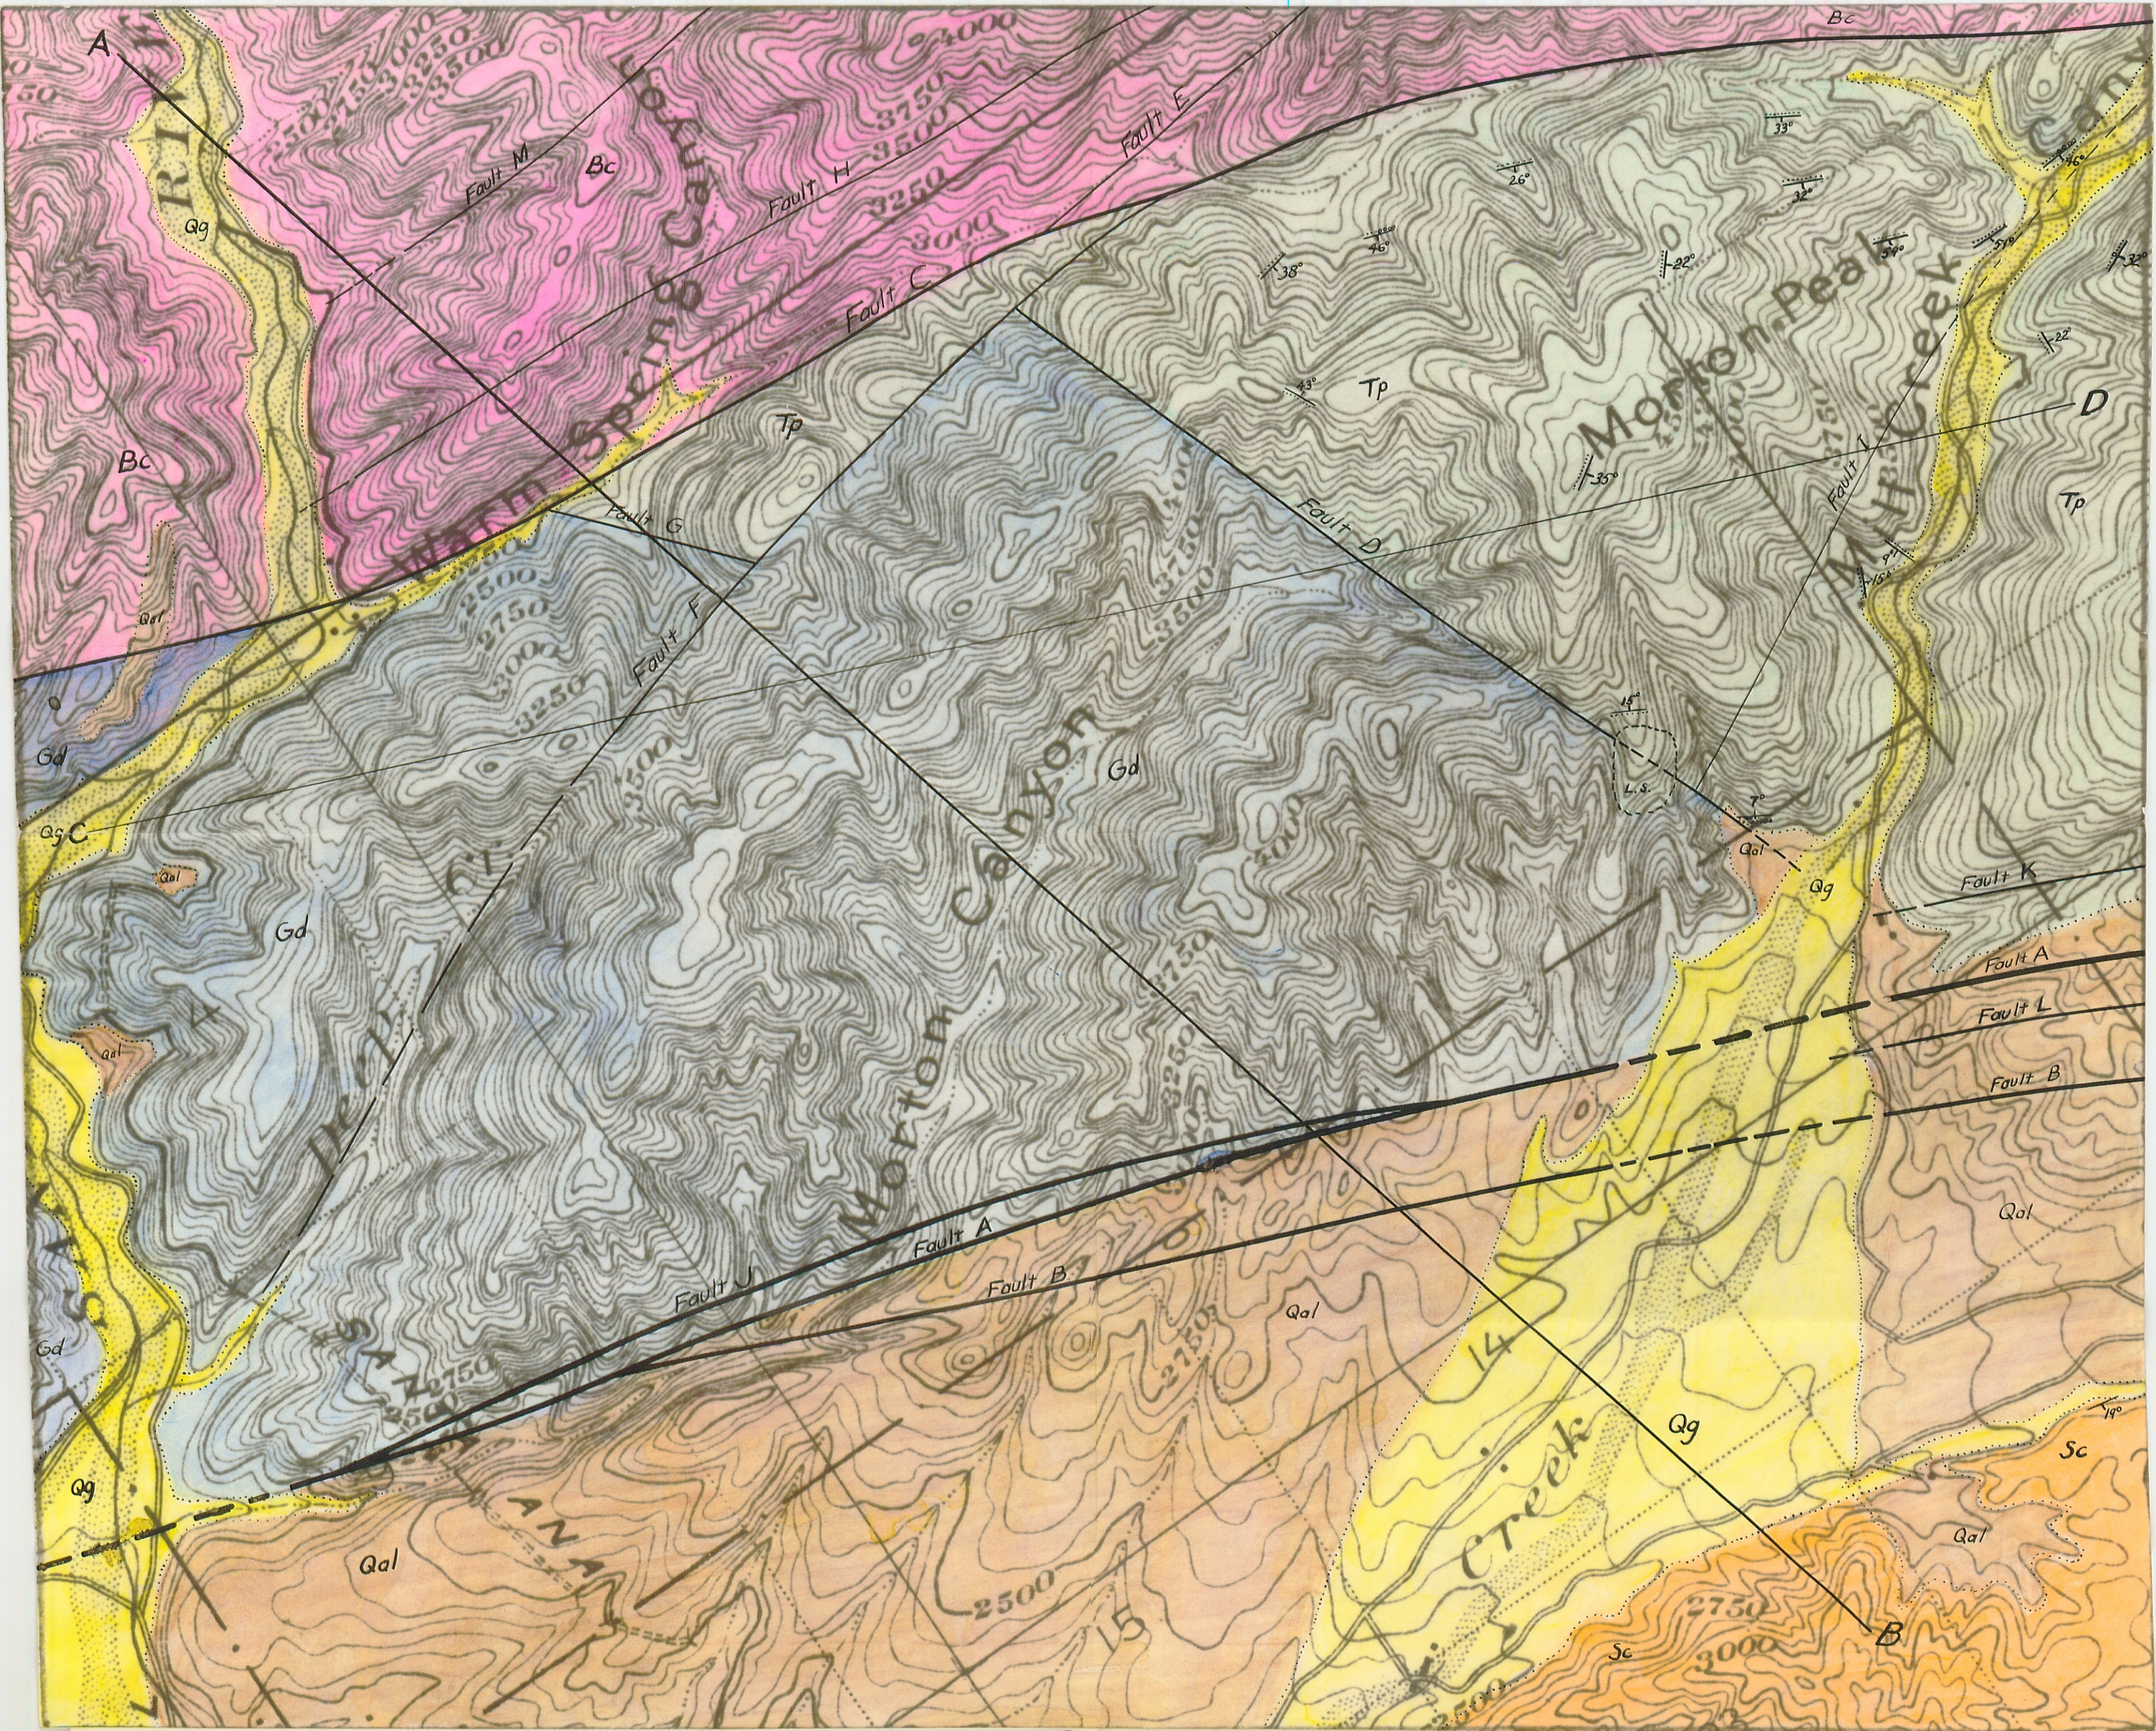


Faults
Exposed ———
Probable - - - -

Contact
Dip and Strike 35°

Landslide (L.S.)

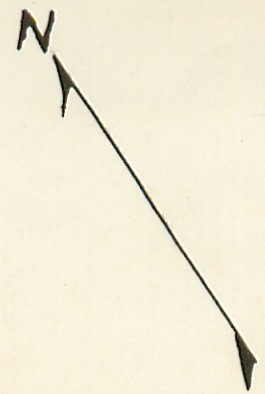

Stream Gravels	Quaternary Alluvium	Potato Sandstone	Schists	Grano-diorite	Basement Complex
Qg	Qal	Tp	Sc	Gd	Bc

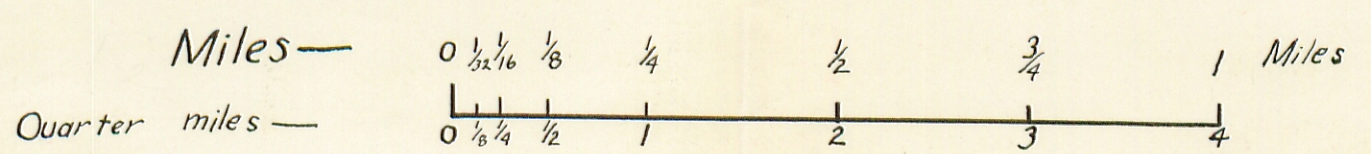

Bolles-lw-1931
BS 1931